

# Installation instructions - 100 I/Impuls



## MNKI-N, MNKI-RP-N

1. Clean the slot of the glass face ensuring that no dirt enters into the screw drill holes. Insert the reed switch into the slot. (Note: Cover of meter has been removed for clarity).
2. Place the clear cover over the reed switch and screw both parts together as shown. Tighten the screws until the lid meets the reed switch housing and is not free to move. (Do not overtighten).
3. Ensure the lid and glass are clean and dry. Seal the screws against tampering by affixing the provided sticker.



### Wire Color Code 10/100 I/Impuls

The circuit diagram and colour code for the wires is as shown below. The brown and white wires are normally connected to the remote reading equipment. Unused wires should either be terminated in a junction box or suitably sealed against water ingress when used outdoors.

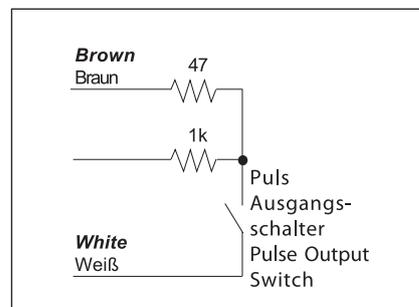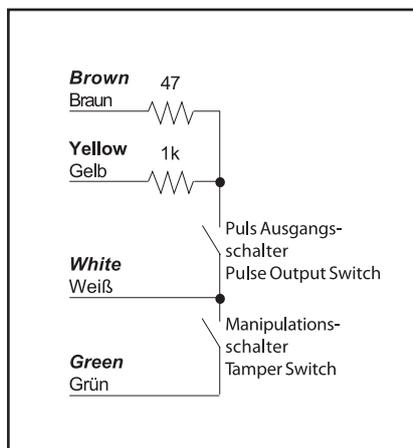

Maximum Switched Voltage: 180 VDC,  
 Maximum Switched Current: 500 mA,  
 Maximum Switched Power: 10 W /